

OPTIMAL PERFORMANCE OF HYBRID WIND-SOLAR SYSTEM WITH CFSI

D.Sathishkumar¹, P.Sankar²

¹M.Tech Student, ²Asst. Prof.,
Dept. Of Electrical and Electronics Engg.
CSI College of Engineering, Tamil Nadu,(India)

ABSTRACT

Renewable energy systems, such as photovoltaic (PV) and wind power generation (WPG), are playing a more and more important role in energy production. However, the output power of PV and WPG are usually strongly fluctuant due to the randomness and intermittence of solar and wind energy, which requires a large capacity of energy storage to satisfy the load demand when the system works in stand-alone mode, and results in a strong impact on the utility grid when the system works in grid-connected mode. Here we are going to utilize that two combined generation very wisely using mppt concept; and there by using mppt technique we are charging and discharging the battery based on power generation & typical load conditions respectively. Due to which battery life is increased. Here wind power generation is considered as primary source as it exists day fully comparing with solar generation. As we know current fed topology is able to provide constant current even at load variations; we utilized that topology for grid loads.

Keywords -- Cfsi, Mppt, PV Cell ,Simulation ,Wind

I. INTRODUCTION

As energy demands around the world increase, the need for a renewable energy sources that will not harm the environment has been increased. Some projections indicate that the global energy demand will almost triple by 2050[1]. Renewable energy sources currently supply somewhere between 15% and 20% of total world energy demand. PV and Wind Energy System, WES, are the most promising as a future energy technology. A 30% contribution to world energy supply from the renewable energy sources by year 2020 [2] as in would reduce the energy related CO₂ emission by 25 %.

With their advantages of being abundant in nature and nearly non pollutant, renewable energy sources have attracted wide attention. Wind power is one of the most promising clean energy sources since it can easily be captured by wind generators with high power capacity. Photovoltaic (PV) power is another promising clean energy source since it is global and can be harnessed without using rotational generators. In fact, wind power and PV power are complementary to some extent since strong winds are mostly to occur during the night time and cloudy days whereas sunny days are often calm with weak winds . Hence, a wind–PV hybrid generation system can offer higher reliability to maintain continuous power output than any other individual power

generation systems. In those remote or isolated areas, the stand-alone wind–PV hybrid generation system is particularly valuable and attractive.


To maximize a photovoltaic (PV) and wind energy system's output power, continuously tracking the maximum power point (MPP) of the system is necessary. Most of the researches haven't modelling and simulation of PV/Wind HEPS techniques by using MPPT at the point of connection of operation in details. So, the main objective of this paper is maximizing the PV output power and wind output power independently by tracking the maximum power on every operating condition by using MPPT technique and interconnected to utility grid.

II. SYSTEM CONFIGURATION

2.1 HYBRID RENEWABLE ENERGY SYSTEMS

A combination of different but complementary energy generation systems based on renewable energies or mixed is known as a hybrid power system. Hybrid systems capture the best features of each energy resource. Hybrid systems can provide a steady community level electricity service, such as marine, village or lighthouse electrification, offering also the possibility to be upgraded through grid connection in the future. Furthermore, due to their high levels of efficiency, reliability and long term performance these systems can also be used as an effective backup solution to the public grid in case of blackouts or weak grids, and for professional energy solutions such as telecommunication stations or emergency rooms in hospitals. When designing a hybrid system it is important to choose a good combination of components, their dimensions and to determine a good strategy to manage the system that would be reliable and economical for a long time. A large number of resources will result in large investment costs, while a system with a small number of components can result in the interruption of electricity supply in the electricity system. Climatic conditions may affect the choice of renewable energy sources. For example, PV hybrid systems are ideal in areas with warm climates and in areas where there is large number of sunny hours.

BLOCK DIAGRAM:

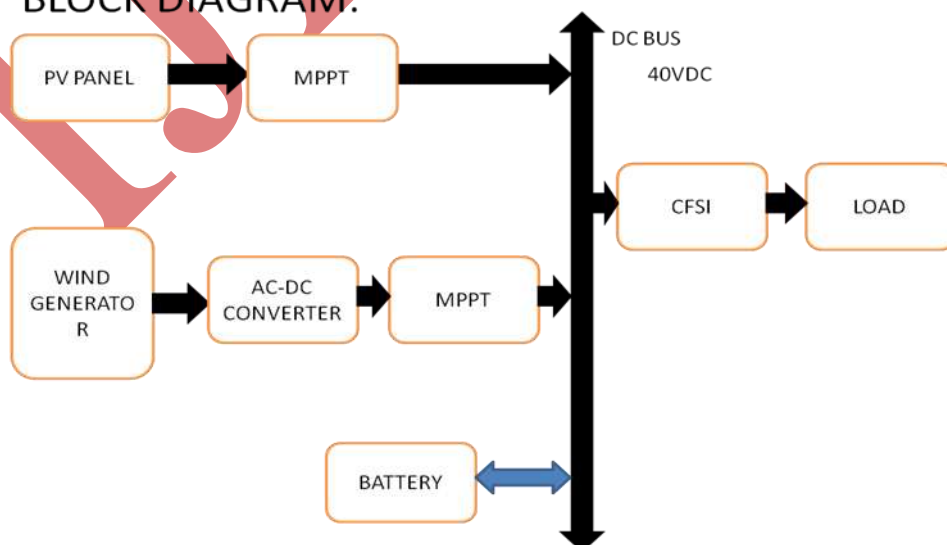

This paper presents a current-fed dc/dc topology (CFT) based inverter. The new inverter is named current-fed switched inverter (CFSI). It has the following characteristics.

- 1) It combines the advantages of both ZSI and SBI. The gain of the proposed circuit is the same as the ZSI. It also has the same component count as the SBI.
- 2) The proposed inverter possesses good EMI noise immunity similar to ZSI and SBI.
- 3) The proposed inverter draws continuous input current from the dc source, which makes it suitable for renewable applications.
- 4) It does not require dead-band for the switching signals, and hence, output waveform distortion is avoided.
- 5) It does not require extreme duty ratio operation to achieve high voltage boost.

2.2 ENERGY MANAGEMENT AND OPTIMIZATION PRINCIPLES

According to the connection bus, the network architecture of WSB can be classified into three types: dc-bus, ac-bus, and hybrid-bus, among which, the dc-bus architecture has been widely used in small-scale DPGS for its convenient control and interface of renewable energy to the system. The PV panel and wind turbine are connected to the dc bus by the dc/dc and ac/dc converters, respectively, which can realize the maximum power point tracking (MPPT) function. The battery cells are connected to the dc bus dc/dc converter in a concentrated location, which are used to control the dc bus voltage. Please note that the storage system is composed of many battery modules connected in series or parallel. The balance circuits among different modules are usually included in the system. The dc voltage is converted to ac voltage through an inverter. The power generated by WSB provides the demanded power for the local load and can be transferred into the utility grid through a step-up transformer.

2.3 OPTIMAL SIZING PRINCIPLES OF WSB

For a given load demand, fully utilizing the complementary characteristics of wind and solar can achieve a smaller fluctuation of output power, which results in a reduction of the required battery capacity. It is obvious that there exists power exchange between the WSB and utility grid in grid connected mode. A strongly fluctuant power injected into the grid may lead to the voltage or frequency at key nodes exceeding their limitation and large losses. Thus, how to smooth the fluctuation of power injected into the grid must be taken into account when optimizing the capacity of PV/WPG/battery. In addition, the lifetime of WSB is usually restricted by the lifetime of the battery, which is mainly affected by the batteries DOD, the charge/discharge current, and the charge/discharge rate and the charge/discharge cycles. Thus, these factors must be considered. According to the analysis above, the proposed optimal sizing method is based on the following principles:

- a) Achieving high power supply reliability
- b) Making full use of the complementary characteristics of wind and solar
- c) Ensuring a small fluctuation of power injected into the grid
- d) Optimizing the battery's charge and discharge state
- e) Minimizing the total cost of WSB

III. REVIEW OF THE CURRENT-FED DC/DC TOPOLOGY

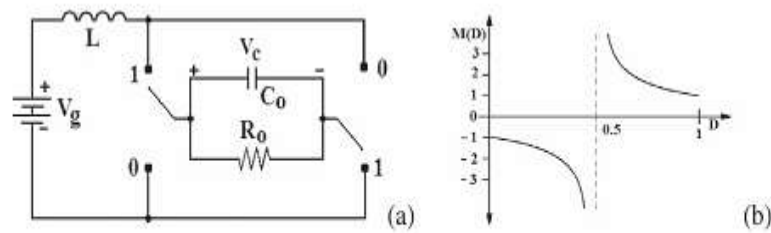


Fig. 3. (a) Circuit diagram of the current-fed dc/dc topology (CFT).
(b) Conversion ratio of the CFT.

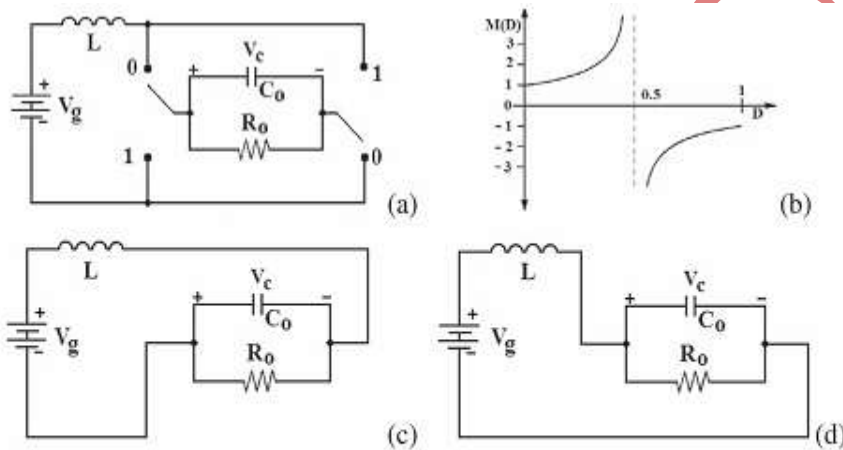


Fig. 4. (a) Circuit diagram of the complementary current-fed dc/dc topology (CCFT). (b) Conversion ratio of the CCFT. (c) CCFT with switch at position 1.
(d) CCFT with switch at position 0.

Current-fed dc/dc converter can provide high boost without operating at extreme duty cycle condition. In the boost converter, the inductor charges the output capacitor only during $(1-D)$ interval in a switching cycle. However, the current-fed dc/dc converter utilizes both D and $(1-D)$ intervals to boost up the output voltage to a high value. The circuit diagram of the current-fed dc/dc topology (CFT) is shown in Fig. 3(a). Under continuous conduction mode (CCM) operation, in D interval (position 1 of the switch), the output terminals are connected across the inductor and ground. In $(1-D)$ (position 0 of the switch) interval, the output terminal connections are reversed. From the volt-second balance of the inductor L [8], the conversion ratio of CFT can be obtained as in the following and as shown in Fig. 3(b).

$$B_{CFT}(D) = \frac{V_c}{V_g} = \frac{1}{2D - 1}.$$

From the transfer characteristic of Fig. 3(b), it is noted that the converter gain is negative when the duty ratio (D) of the converter is between 0 and 0.5, and the gain is positive when D is beyond 0.5. Fig. 4(a) shows the complementary current-fed topology (CCFT) structure which is obtained by interchanging the D and $(1-D)$ intervals of the CFT structure. In this case, the controlled switches and the passive switches are interchanged in order to get the CCFT structure from the CFT structure. The equivalent circuits of the CCFT

converter in the D and D intervals are shown in Fig. 4(c) and (d), respectively. Using inductor volt-second balance [8], the steady-state output to input conversion ratio can be derived as

$$B_{CCFT}(D) = \frac{V_c}{V_g} = \frac{1}{1 - 2D}.$$

The conversion ratio is plotted in Fig. 4(b). When $D < 0.5$, the output of the converter is positive. For $D > 0.5$, the output polarity becomes negative. In this paper, $D < 0.5$ is only considered as a valid region of operation to make switch realization easier.

IV. MATHEMATICAL MODEL OF THE COMPONENTS IN WSB

4.1 PHOTOVOLTAIC GENERATION MODEL

Assuming that the PV array is equipped with a MPPT controller, thus, the output power of PV array can be expressed as

$$P_{pv} = f_{pv} P_{pv,r} \frac{G}{G_{STC}} [1 + \alpha_T (T - T_{STC})]$$

Where is the rated output power of PV array, is the de rating factor considering shading, wiring losses and snow cover, etc. and are the solar radiation and temperature on PV cell under standard test conditions, respectively. And are the solar radiation and temperature in current time, respectively, and is the temperature coefficient of power. It should be noted that the PV panel title angle, rotating capability, etc. can also affect the output power of PV array beside and . In this study, these factors are taken into account when calculating the solar radiation on PV panel.

4.2 WIND POWER GENERATION MODEL

The output power curve of the wind turbine (WT), which can be described as

$$P_{wt} = \begin{cases} 0 & v_w < V_{ci} \text{ or } v_w > V_{co} \\ P_{wt,r} \frac{v_w - V_{ci}}{v_r - V_{ci}} & V_{ci} \leq v_w \leq V_r \\ P_{wt,r} & V_r \leq v_w \leq V_{co} \end{cases}$$

Where is the wind speed, is the rated wind speed, and are the cut-in and cut-out wind speeds, respectively.

MPPT METHODS

MPPT algorithms are necessary in renewable energy sources to gain maximum power and efficiency. There is a large number of algorithms that are able to track MPPs. Over the past decades many methods to find the MPP have been developed. These techniques differ in many aspects such as required sensors, complexity, cost, range of effectiveness, convergence speed, correct tracking when irradiation and/or temperature changes, hardware needed for the implementation. Having a curious look at the recommended methods, P&O and incremental conductance are the algorithms that were in center of consideration because of their simplicity and ease

of implementation. However the P&O algorithm cannot compare the array terminal voltage with actual MPP voltage, since the change in power is only considered to be a result of array terminal voltage perturbation. As a result, they are not accurate enough because they perform steady state oscillation, which consequently waste the energy. By minimizing the perturbation step size, oscillation can be reduced, but a smaller perturbation size slows down the speed of tracking MPPs. Thus, there are some disadvantages with these methods, where they fail under rapidly changing atmospheric conditions. The IncCond method is the one which overrides over the aforementioned drawbacks. In this method, the array terminal voltage is always adjusted according to the MPP voltage. It is based on the incremental and instantaneous conductance of the PV module. The slope of the PV array power curve is zero at the MPP, increasing on the left of the MPP and decreasing on the right-hand side of the MPP. The basic equations of this method are as follows

$$\frac{dI}{dV} = -\frac{I}{V} \quad \text{at MPP} \quad (1)$$

$$\frac{dI}{dV} > -\frac{I}{V} \quad \text{left of MPP} \quad (2)$$

$$\frac{dI}{dV} < -\frac{I}{V} \quad \text{right of MPP} \quad (3)$$

Where, I and V are the PV array output current and voltage respectively. The left-hand side of the equations represents the IncCond of the PV module, and the right-hand side represents the instantaneous conductance. From (1)–(3), it is obvious that when the ratio of change in the output conductance is equal to the negative output conductance, the solar array will operate at the MPP. In other words, by comparing the conductance at each sampling time, the MPPT will track the maximum power of the PV module. The accuracy of this method is proven in, where it mentions that the IncCond method can track the true MPPs independent of PV array characteristics. Incremental conductance algorithm is based on the fact that the slope of the curve power vs. voltage (current) of the PV module is zero at the MPP, positive (negative) on the left of it and negative (positive) on the right. By comparing the increment of the power vs. the increment of the voltage (current) between two consecutive samples, the change in the MPP voltage can be determined. MPPT method, where it has made a comprehensive comparison between P&O and the IncCond method with boost converter and shows that the efficiency of experimental results is up to 95%. Efficiency was observed to be as much as 98.2%, but it is doubtful of the IncCond method reliability issues due to the noise of components. Some modifications and reformations were proposed on this method so far, but since this method inherently has a good efficiency, the aforementioned amendments increase the complexity and cost of the system and there was no remarkable change in system efficiency. The disadvantage of the perturb and observe method to track the peak power under fast varying atmospheric condition is overcome by IC method. The IC can determine that the MPPT has reached the MPP and stop perturbing the operating point. If this condition is not met, the direction in which the MPPT operating point must be perturbed can be calculated using the relationship between dI/dV and $-I/V$. This relationship is derived from the fact that dP/dV is negative when the MPPT is to the right of the MPP and positive when it is to the left of the MPP. This algorithm has advantages over P&O in that it can determine when the MPPT has reached the MPP, where P&O oscillates

around the MPP. Also, incremental conductance can track rapidly increasing and decreasing irradiance conditions with higher accuracy than perturb and observe method.

The below algorithm shows that, how the controller follows the mathematical method to generates the required pulses to track the maximum power from the system.

The respective algorithm of incremental conductance MPPT method is shown below.


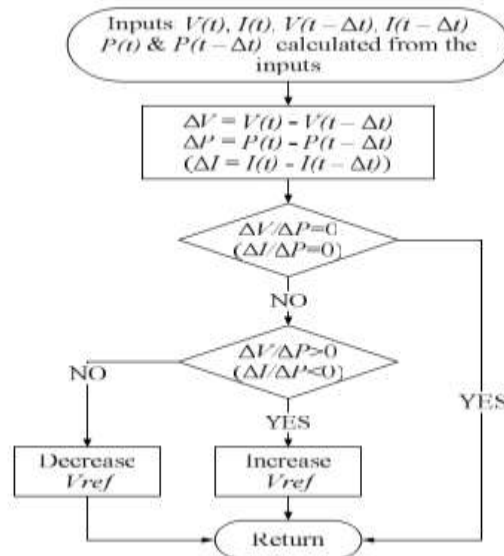



Fig . inc cond algorithm

V. SIMULATION CIRCUIT

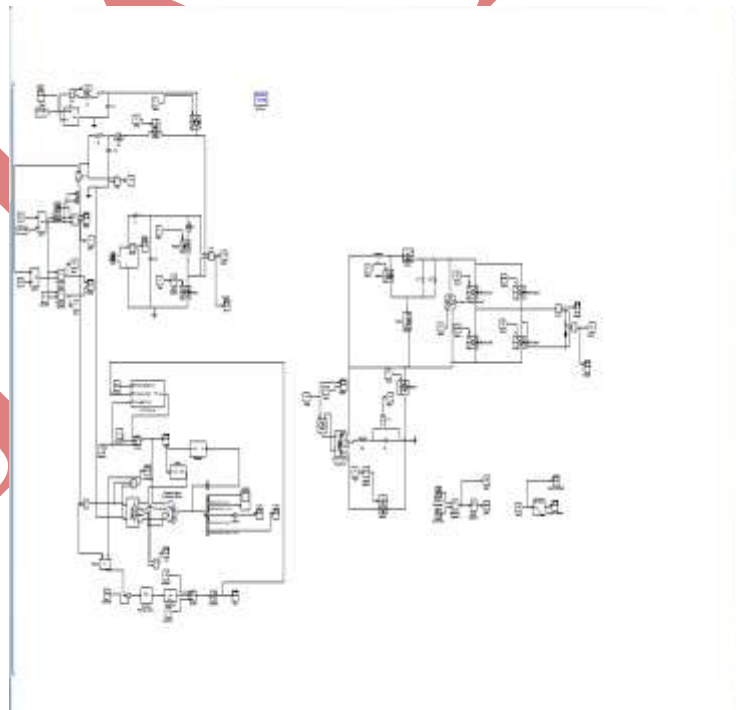

VI. SIMULATION RESULTS

6.1 MATLAB SIMULATION

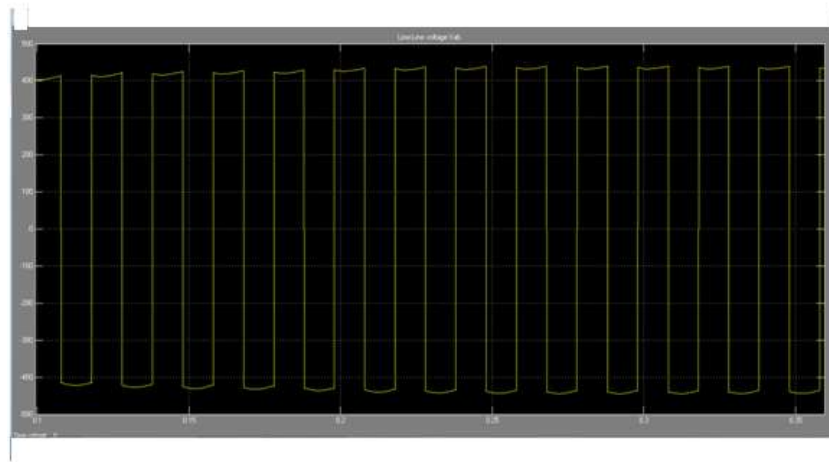

VII. CONCLUSION AND FUTURE ENHANCEMENT

This project is focused on hybrid power generation using single phase inverter. The input is from three different sources namely solar power from photo voltaic cell, wind power from wind generator and a battery source. Battery source acts as effective backup storage. This system provides continuous power supply. A common dc bus is responsible for the dc outputs from the sources and act as a single input to the inverter. Further this inverter converts it into ac and boost the voltage and given to the respective loads. Here we are going to utilize that two combined generation very wisely using mppt concept; and there by using mppt technique we are charging and discharging the battery based on power generation & typical load conditions respectively. Due to which battery life is increased. Here wind power generation is considered as primary source as it exists day fully comparing with solar generation. As we know current fed topology is able to provide constant current even at load variations; we utilized that topology for grid loads. This project proposes a simple system for continuous power supply with the effective utilization of renewable energy sources. This system can be made as a closed loop for further developments.

REFERENCES

- [1]. D.B. Chia, B.L. Yong, R.K. Rajkumar, V.K. Ramachandaramurthy, "Design of a PV/Wind Hybrid System for Telecommunication Load in Borneo Region" Power Quality Research Group, Dept. of Electrical Power Engineering Universiti Tenaga Nasional (UNITEN) Malaysia.
- [2]. O. E. M. Youssef, N. M. B. Abdel-Rahim, A. Shaltout, "Performance of Stand-alone Hybrid Wind-Photovoltaic System with Battery Storage" 14th International Middle East Power Systems Conference (MEPCON'10), Cairo University, Egypt, December 19-21, 2010.
- [3]. Monica Alonso , Hortensia Amaris, Carlos Alvarez-Ortega , "Integration of renewable energy sources in smart grids by means of evolutionary optimization algorithms" University Carlos III of Madrid, Electrical Engineering Department, (2012).
- [4]. M. Druga, C. Nichita, G. Barakat and E. Ceanga, "Stand-Alone Wind Power System Operating with a Specific Storage Structure" International Conference on Renewable Energies and Power Quality (ICREPQ'09) Valencia (Spain), 15th to 17th April, 2009
- [5]. S. Arul Daniel and N. AmmasaiGounden, "A Novel Hybrid Isolated Generating System Based on PV Fed Inverter-Assisted Wind-Driven Induction Generators," IEEE Trans. On Energy Conversion, vol. 19, no. 2, June 2004.
- [6]. Fengge Zhang, Quanfu Shi, Yuxin Wang, FengXiang Wang, "Simulation Research on Wind Solar Hybrid Power System Based on Fuzzy-PID Control," Proc. Of Int. Conf. on Electrical Machines and Systems, Oct 8-11, 2007.
- [7]. Integration Limit of Renewable Energy Systems in Small Electrical Grid Gilles Nottone, Ludmil Stoyanovb, Motaz Ezzata, Vladimir Lararovb, Said Diafc, Christian Cristofaria.
- [8]. D. S. Strebkov, "The Role of Solar Energy in the Power Engineering of the Future", All-Russia Research Institute for Electrification of Agriculture (VNIIESKh), Pervyi Veshnyakovskii pr. 2, Moscow, 109456 Russia, Vol. 53, No. 3. 2006.
- [9]. Emanuel Serban, Helmine Serban, "A Control Strategy for a Distributed Power Generation Micro grid Application with Voltage and Current Controlled Source Converter", IEEE Transactions on, 25(12), 2981-2992, 2010.
- [10]. www.ieee.com
- [11]. www.elsevier.com